

Figure 4-34. Steel Creek seasonal temperatures for cooling towers (2.8°C approach) with total recirculation.

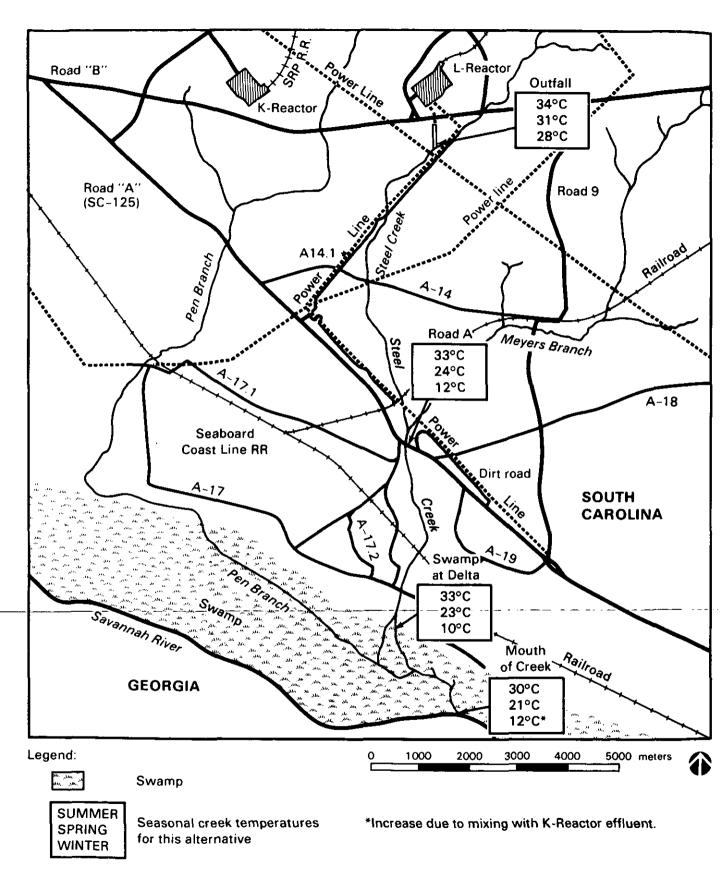


Figure 4-35. Steel Creek seasonal temperatures for cooling towers (8.4°C approach) with total recirculation.